



ENCLOSURE - FRONT VIEW
(42"H x 30"W x 12"D)

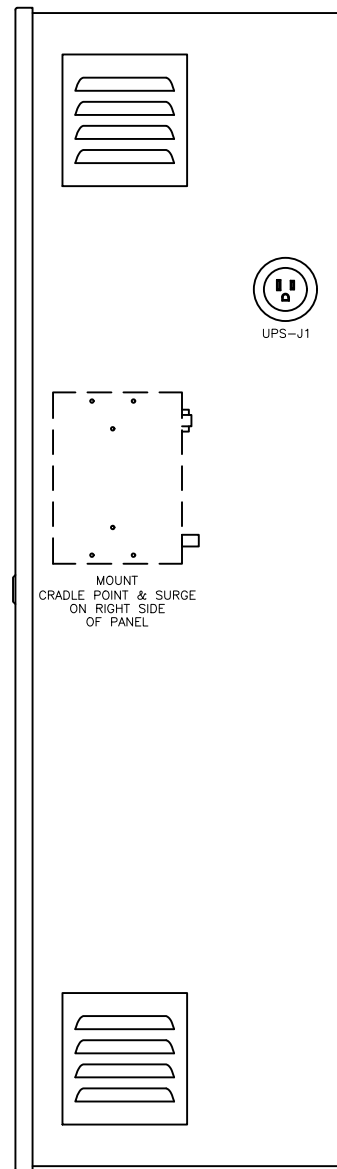

SIDE VIEW

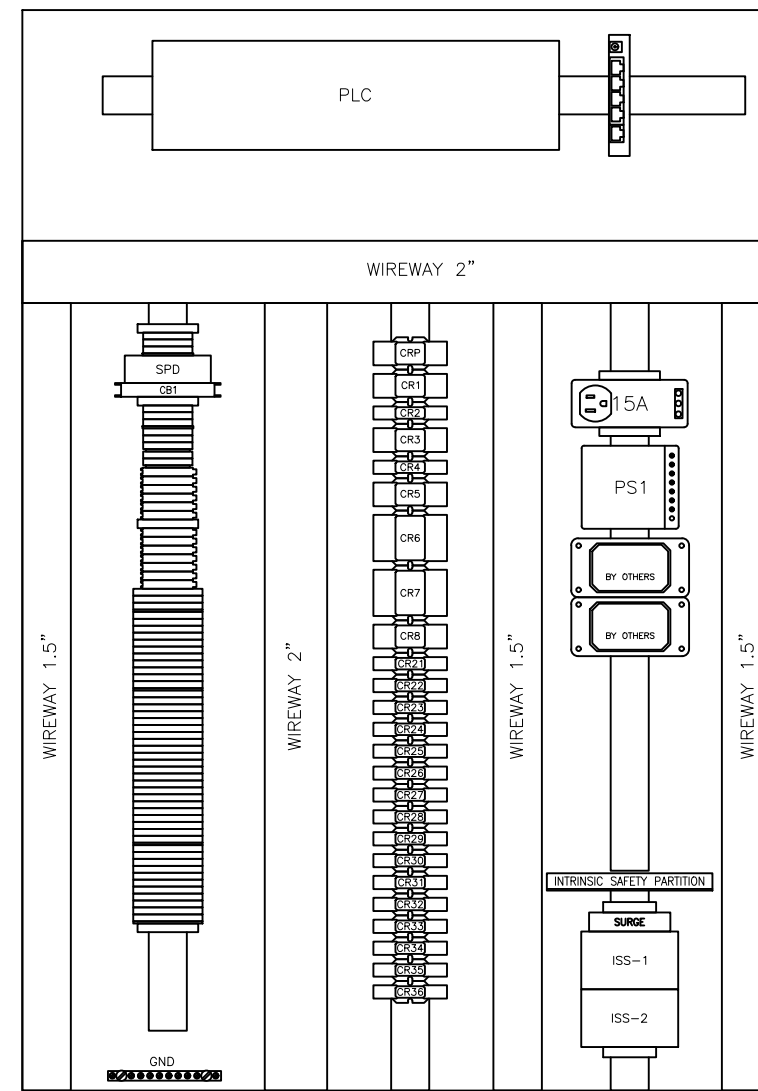

SUB PANEL
(39"H x 27"W)

ENGRAVING CHART				
REF.	NAME PLATE SIZE	TEXT HEIGHT	LINE	TEXT
NP-01	8" x 1"	1/2"	L1	PUMP CONTROL PANEL
NP-02	4" x 1"	3/8"	L1	PUMP 1
NP-03	4" x 1"	3/8"	L1	FLOAT SYSTEM
NP-04	4" x 1"	3/8"	L1	PUMP 2

NOTES:
 1. NAMEPLATES: WHITE LAMICOID (2-PLY) WITH BLACK ENGRAVED LETTERS.
 2. ATTACH WITH S.S. DRIVE SCREWS (COAT REAR OF SCREW WITH SILICON SEAL).

NOTES:

- CONSTRUCTION: WALL MOUNTED, NEMA 12 ENCLOSURE.
 A. ENCLOSURE: 14 GAUGE STEEL.
 B. SUB-PANEL: 12 GAUGE STEEL.
- FINISH:
 A. ENCLOSURE: INTERIOR & EXTERIOR ANSI 61 GRAY ENAMEL OVER PHOSPHATIZED SURFACES.
 B. SUB-PANEL: WHITE ENAMEL.
- CONFIRM SERVICE AVAILABILITY WITH POWER COMPANY.
- CELLULAR MODEM DEVICE SHALL BE CRADLE POINT PART #TB5-650C150M-NON. (PROVIDED BY SUSSEX COUNTY)



SUSSEX COUNTY ENGINEERING DEPARTMENT

APPROVED: *[Signature]*
 SUSSEX COUNTY ENGINEER

PUMP CONTROL PANEL LAYOUT
 THREE PHASE SERVICE

DETAIL

I-22

LAST REVISED:

4/25/2023